



Closed Top Tank With Clean Out



Symbol	A	B	C	D	E	Inlet	Outlet	Vent	Clean Out	Volume
W32506	15"	12"	9"	9"	5.5"	1.5"	1.5"	1.5"	6"	5 Gal
W32507	11-1/2"	12"	9"	9"	4."	1.5"	1.5"	1.6"	6"	4 Gal

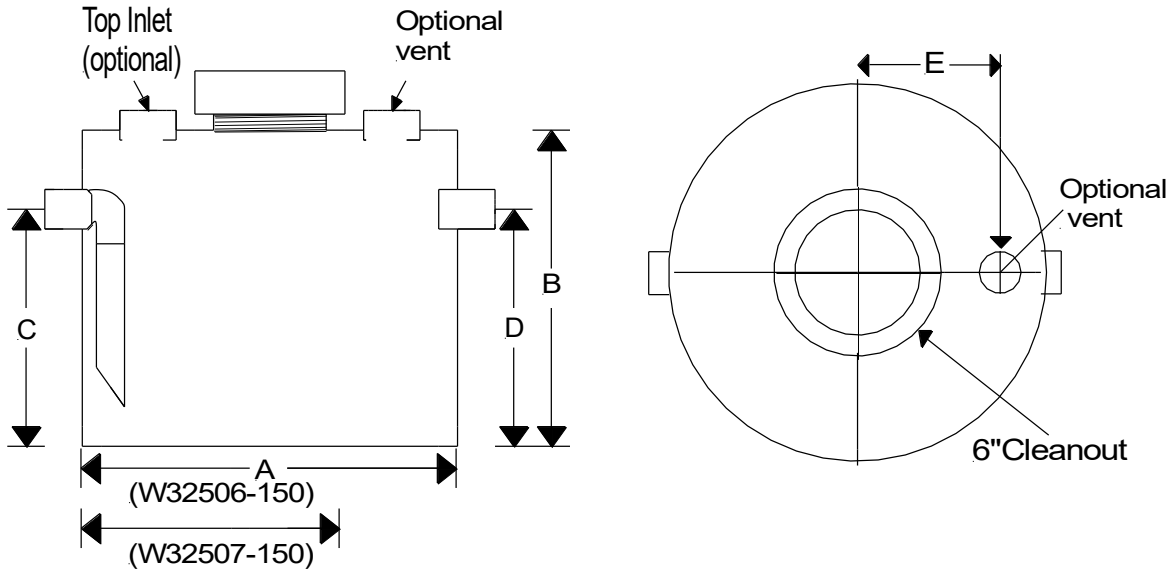

TOP VIEW FOR INLET/OUTLET LOCATIONS

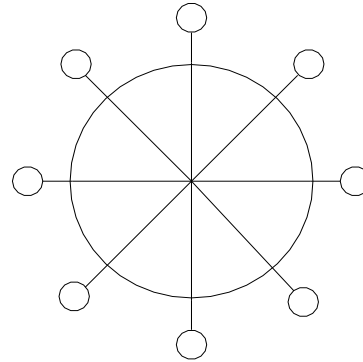

CONNECTIONS FOR TANK	
TYPE	SIZE
INLET	_____
OUTLET	_____
VENT	_____ <input type="checkbox"/> TOP <input type="checkbox"/> SIDE

Tanks should be of seamless construction, rotationally molded in the USA. From HD polyethylene resin conforming to ASTM D-1998-06 and ASTM D-4976. External fittings conforming to ASTM F-1412, shall be polyfused and/or welded to the tank, and be provided with the inlet dip pipe extending down to the bottom. The effluent must be discharged at the bottom of the tank to maximize dwell time. Covers are either bolted down or welded to the tank. The inside bottom of the tank shall be flat with no recessed areas where acid waste or other contaminants can pool.